


Daikin FVQ125/RZQSG125LV1

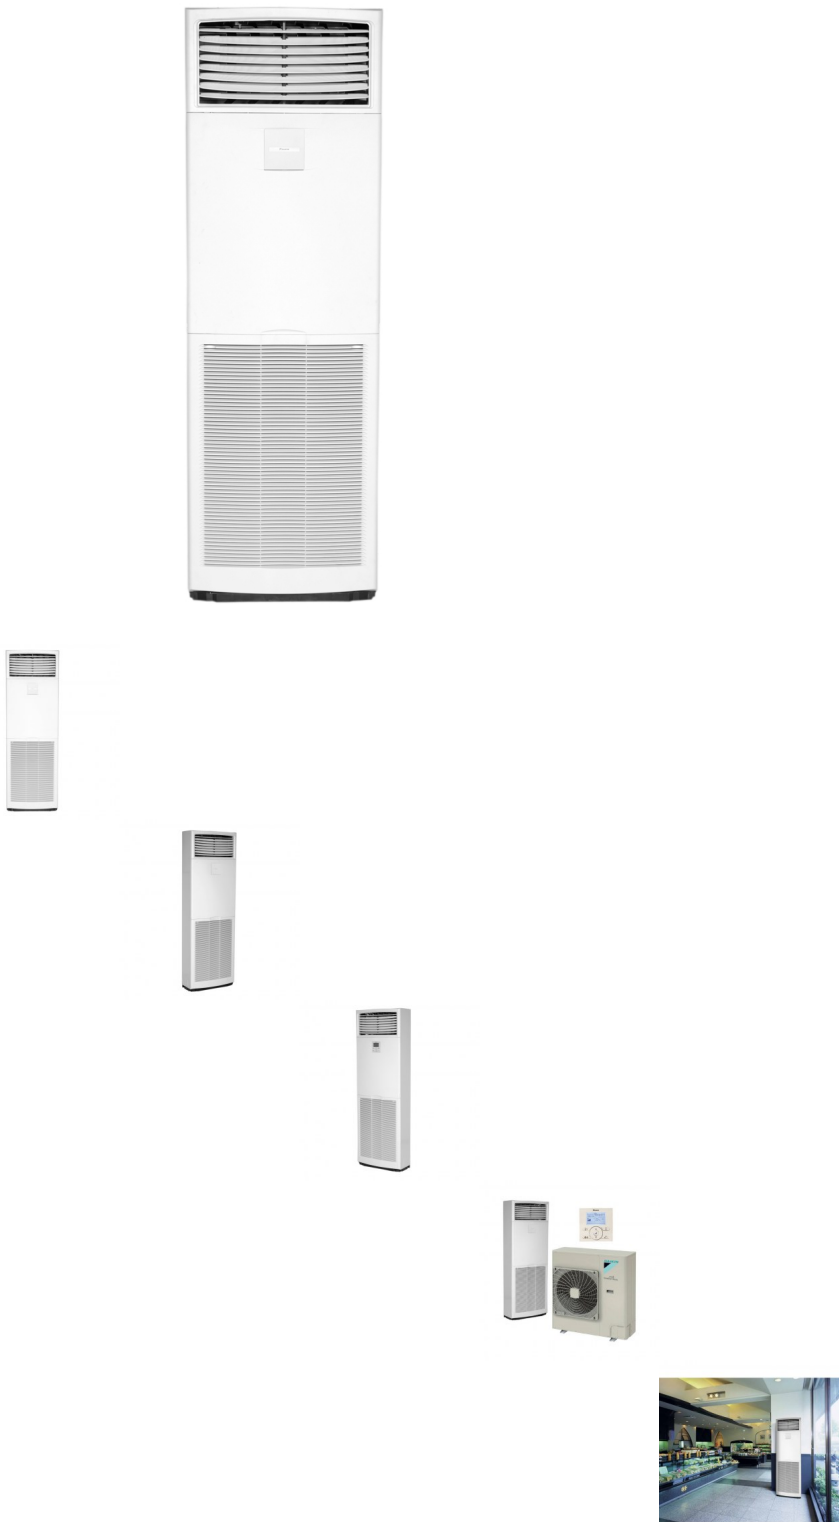

?????????: ??? ????????????? ?????

????????? : Daikin FVQ125/RZQSG125LV1

???

3158 €

[????? ??? ??????? ??? ?? ??????](#)

????????????? [Daikin](#)

?????????

????????????? Daikin FVQ125/RZQSG125LV1

- ?????? ??? ???? ??????????, ?????????? ? ?????? ?? ?????? ? ?????? ??????? ??????????
- ?????? ?? ?????????????? ??? ???? ???? ?????????? ??? ???? ???? ?????????? ??????
- ??? ???? ?????????????? ??? ?????? ?? ?????????????? ??????
- ?????? ??? ?????????????? ?????????????? ?? ??? ?????????? ??????? ?????????? ?????????? ? ?? ?????????? ?????????? ??????????
- ?????????? ?????????? 3 ??????????????
- ?????????? ?????? ??? ???? ?????????? ??????? ??? ???? ?????????? ??????, ??? ?????????? ?????????????? ??????? ??? ??????????
- ?????? ??? ???? ???? ???? ???? ??????. ?????????? ?????????? ?????????? ??????? ??? ???? ??? ?????????? ?????????? ??? ??????? ???
- ?????????? ??? ?????? (?? ?? BRC1E52)
- ?????????? ??????? ?? ??? ?????????? DC ??????????
- ??? ?????????? ?????????????? ?????????? ??? ??????? DIII, ??????? ?? ?????? ??? ??? ?????????? ??????? ?????????? ??? ???????

?????????????????

❏ ??? - BTU: 40000

❏ ??? - ?????????? ?????: C

❏ SEER: 4.31

????????????? ????. M?????(mm): 1850/600/350

?????? ??????? ?????.????????: 46/58/63 dB

 [??????????](#)

❏ ??????? - BTU: 46000

❏ ??????? - ?????????? ?????: A

❏ SCOP: 3.81

????????????? ????. M?????(mm): 990/940/320

?????? ??????? ?????.????????: 54/58/70 dB

?????? ???????

??? ?????????? ?????????????? ??? ?? ?????? ?????.